

GENERAL NOTES:


- ALL WORK SHALL BE COMPLETED IN ACCORDANCE WITH THE CURRENT "OCCUPATIONAL HEALTH AND SAFETY ACT AND REGULATIONS FOR CONSTRUCTION PROJECTS". THE GENERAL CONTRACTOR SHALL BE DEEMED TO BE THE CONSTRUCTOR AS DEFINED IN THE ACT.
- ALL TEMPORARY TRAFFIC CONTROL AND SIGNAGE DURING CONSTRUCTION SHALL BE IN ACCORDANCE WITH CURRENT ONTARIO TRAFFIC MANUAL BOOK 7 TEMPORARY CONDITIONS FIELD EDITION.
- ALL THE CONSTRUCTION WORK FOR THIS PROJECT SHALL COMPLY WITH THE STANDARD DRAWINGS AND SPECIFICATIONS OF THE CITY, THE REGION AND THE ONTARIO PROVINCIAL STANDARDS AND SPECIFICATIONS.
- THE CONTRACTOR IS ADVISED THAT WORKS BY OTHERS MAY BE ONGOING DURING THE PERIOD OF THIS CONTRACT. THE CONTRACTOR SHALL COORDINATE CONSTRUCTION ACTIVITIES WITH ALL OTHER CONTRACTORS AND PREVENT CONSTRUCTION CONFLICTS.
- THE INFORMATION SHOWN FOR EXISTING UTILITIES WAS PROVIDED BY OTHERS. THE CONTRACTOR IS RESPONSIBLE FOR LOCATING AND PROTECTING ALL UTILITIES DURING CONSTRUCTION. ALL EXISTING UTILITIES MUST BE LOCATED AND VERIFIED BY EACH UTILITY PRIOR TO COMMENCEMENT OF WORK. ANY VARIANCE IS TO BE IMMEDIATELY REPORTED TO THE ENGINEER. LOST TIME DUE TO FAILURE OF THE CONTRACTOR TO CONFIRM UTILITY LOCATIONS AND NOTIFY THE ENGINEER OF CONFLICTS PRIOR TO CONSTRUCTION WILL BE AT THE CONTRACTORS EXPENSE.
- PRIOR TO COMMENCING ANY WORK WITHIN THE MUNICIPAL RIGHT OF WAY, THE CONTRACTOR OR DEVELOPER OR CONSULTANT WILL OBTAIN ALL NECESSARY ROAD OCCUPANCY PERMITS FROM THE CITY'S RIGHT-OF-WAY MANAGEMENT UNIT. ROAD OCCUPANCY ACCESS PERMIT MUST BE OBTAINED 48 HOURS PRIOR TO COMMENCING ANY WORKS WITHIN THE MUNICIPAL ROAD ALLOW.
- ALL WORK TO BE DESIGNED AND COMPLETED AS PER OPSS, OPSP, AND MTD.
- NO ALTERATIONS TO EXISTING BOUNDARY ELEVATIONS OR ADJACENT LANDS SHALL BE UNDERTAKEN UNLESS WRITTEN AGREEMENT WITH THE ADJACENT PROPERTY OWNER IS OBTAINED AND SUBMITTED IN A FORMAT ACCEPTABLE TO THE CITY.

WATERMANS:

- WATERMAIN SHALL BE POLYVINYL CHLORIDE (PVC) CLASS 150 DR-18 PIPE MANUFACTURED TO AWWA C900-89 AND CSA CAN3 B137.3-M1986 WITH GASKETED BELL END CW #14 AWG SOLID COPPER TRACER WIRE.
- WATERMANS SHALL HAVE A MINIMUM VERTICAL CLEARANCE OF 300mm OVER AND 500mm UNDER SEWERS AND ALL OTHER UTILITIES. WHEN CROSSING ALL WATERMANS AND SERVICES SHALL HAVE 180mm MINIMUM COVER.
- BEDDING FOR WATERMANS SHALL BE AS PER OPSP 802.030.
- COVER REQUIRED ON WATERMAIN IS 1.8m MINIMUM.
- ALL WATERMAIN HORIZONTAL AND VERTICAL BENDS, JOINTS AND PLUGS TO BE MECHANICALLY RESTRAINED. THRUST BLOCKS/MECHANICAL RESTRAINERS MUST BE INSTALLED ON ALL WATERMAIN BENDS, TEES, AND PLUGS AS PER LOCAL MUNICIPAL STANDARDS.
- ALL WATERMAIN STUBS SHALL BE TERMINATED WITH A PLUG AND 50mm BLOW OFF UNLESS OTHERWISE NOTED.
- HYDRANT AND VALVE TO BE AS PER OPSP 1105.010.
- ALL HYDRANT FLANGE ELEVATIONS TO BE INSTALLED 0.15m ABOVE PROPOSED FINISHED GRADE AT HYDRANT.
- BUILDING SERVICE VALVES TO BE 3.0m OFF THE FACE OF THE BUILDING UNLESS OTHERWISE NOTED AND MUST BE RESTRAINED A MINIMUM OF 12m BACK FROM STUB.
- PROVISIONS FOR FLUSHING WATERMANS MUST BE PROVIDED WITH A MINIMUM 50mm OUTLET FOR MAINS 100mm AND LARGER. FLUSHING POINTS MATCHING THE SIZE OF THE PIPE MUST BE PROVIDED AT THE END OF EACH COPPER MAIN. FIRE MAIN FLUSHING OUTLETS TO BE 100mm DIAMETER MINIMUM OR A HYDRANT. FLUSHING POINTS MUST BE HOSED OR PIPED TO ALLOW THE WATER TO DRAIN.
- ALL WATERMANS SHALL BE HYDROSTATICALLY TESTED IN ACCORDANCE WITH LOCAL MUNICIPAL AND PROVINCIAL GUIDELINES UNLESS OTHERWISE DIRECTED. PROVISIONS FOR FLUSHING WATER LINE PRIOR TO TESTING, ETC. MUST BE PROVIDED.
- ALL PROPOSED WATER PIPING MUST BE ISOLATED FROM EXISTING MAINS IN ORDER TO ALLOW INDEPENDENT PRESSURE TESTING AND CHLORINATION.
- BOTH THE FIRE AND DOMESTIC WATER SERVICES MUST COMPLY WITH THE CURRENT BUILDING CODE ACT, THE CURRENT WATER SUPPLY BY-LAW, CHAPTER 851 AND CSA B-64 SERIES STANDARDS.

SANITARY & STORM SEWER:

- MANHOLES SHALL BE AS PER OPSP 701.010 AND OPSP 701.011; FRAMES AND COVERS SHALL BE AS PER OPSP 401.010. SAFETY PLATFORMS TO BE INSTALLED WHERE DEPTH EXCEEDS 5.0m.
- MAIN LINE PVC PIPE AS PER SDR-35 CSA B182.2-08 CERTIFIED ASTM D3034-04A, F679-03. SERVICE CONNECTION PVC PIPE TO BE AS PER SDR-28 CSA B182.2-08 CERTIFIED ASTM D3034-04A.
- SINGLE CATCHBASINS SHALL BE AS PER OPSP 705.010, WITH FRAMES AND COVERS AS PER OPSP 400.020. DOUBLE CATCHBASINS SHALL BE AS PER OPSP 705.020.
- CONCRETE PIPE SEWER BEDDING SHALL BE CLASS 'B' AS PER OPSP 802.030. PVC PIPE SEWER BEDDING SHALL BE CLASS 'B' AS PER OPSP 802.030 TO TOP OF SEWER WITH A MINIMUM 300mm SAND COVER OVER PIPE NATIVE BACKFILL TO BE COMPACTED TO A MIN. 98% STANDARD PROCTOR DENSITY.
- ALL STORM SEWER PIPES UP TO 450mm DIA. SHALL BE PVC SDR-35 OR APPROVED EQUIVALENT. ALL STORM SEWER PIPES 525mm DIA. AND LARGER SHALL BE CONCRETE AND EQUAL TO C.S.A. SPECIFICATIONS A257.2 REINFORCED CLASSES AS SPECIFIED (65-D, 100-D, 140-D) OR LATEST AMENDMENT UNLESS OTHERWISE SPECIFIED.
- ALL SANITARY PVC SEWER PIPES SHALL BE SDR-35 EQUAL CSA SPECIFICATIONS B182.2-M1990 OR LATEST AMENDMENT UNLESS OTHERWISE NOTED.
- SANITARY SERVICE CONNECTIONS SHALL BE SINGLE, 150mmØ MINIMUM, PVC CLASS DR 28 INSTALLED AT 2 % AND ANY COLOUR EXCEPT WHITE, FOR SINGLE RESIDENTIAL DWELLINGS.
- SANITARY MAINTENANCE HOLE SHALL HAVE WATERTIGHT FRAME AND COVER IN PONDING AREAS AS PER OPSP 401.030.
- NON-REINFORCED CONCRETE PIPE 150mm TO 250mm SHALL BE AS PER CSA A257.1-03 CLASS 3. HEIGHT OF FILL TO BE VERIFIED USING OPSP TABLES 807.040. BEDDING FOR RIGID PIPE SHALL BE CLASS B AS PER OPSP 802.030, 802.031, 802.032 OR 802.033.
- BEDDING FOR RIGID PIPE SHALL BE CLASS B AS PER OPSP 802.030, 802.031, 802.032 OR 802.033.
- ALL MANHOLE AND CATCH BASIN EXCAVATIONS TO BE BACKFILLED WITH GRANULAR MATERIAL COMPACTED TO 98% STANDARD PROCTOR DENSITY.
- ALL CATCH BASINS AND CATCH BASIN MANHOLES ARE TO INCLUDE SUBDRAIN TREATMENT AS PER DETAIL ON DRAWING D1.
- ALL BLIND CONNECTIONS TO MATCH THE INVERT OF THE CATCH BASIN LEAD TO THE SPRINGLINE OF THE STORM PIPE. OTHERWISE INSTALL THE CATCH BASIN LEAD AT A MAXIMUM 2.00% AND DROP INTO PIPE.
- UNLESS OTHERWISE NOTED, CATCHBASIN LEADS SHALL BE 250mmØ AT MINIMUM 1.00% SLOPE.
- THE CONTRACTOR IS TO PROVIDE CCTV CAMERA INSPECTIONS OF ALL SANITARY AND STORM SEWERS, INCLUDING PICTORIAL REPORT, TWO (2) CD COPIES AND ONE (1) VIDEO TAPE IN A FORMAT SATISFACTORY TO THE ENGINEER. ALL SEWERS ARE TO BE FLUSHED PRIOR TO CAMERA INSPECTION.
- THE CONTRACTOR SHALL CONTACT THE MUNICIPALITY AT LEAST 48 HOURS PRIOR TO CONNECTING TO THE EXISTING SANITARY & STORM MANHOLE.
- SERVICE CONNECTIONS AND UTILITY CUTS TO BE BACKFILLED WITH UNSHRINKABLE FILL.

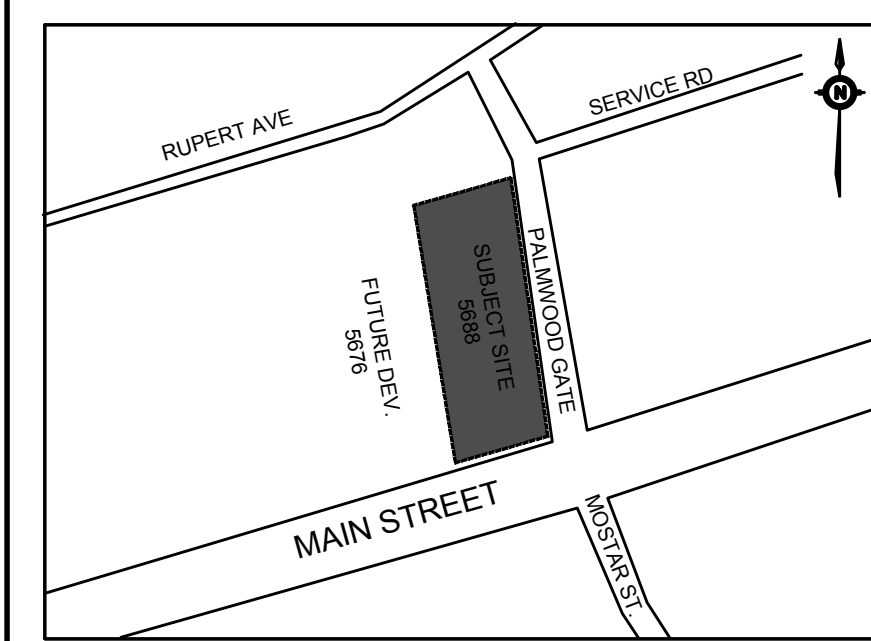

KEY PLAN  
N.T.S.  
ADDRESS:  
5688 MAIN STREET, WHITCHURCH-STOUFFVILLE, ONTARIO

LEGEND  
SEE ABBREVIATIONS BELOW

- PROPOSED ITEMS  
EXISTING ITEMS  
LIMIT OF PROPERTY LINE  
LIMIT OF CONSTRUCTION  
LIMIT OF BUILDING STRUCTURE  
LIMIT OF UNDERGROUND STRUCTURE  
BUILDING ENTRANCE  
SANITARY SEWER  
STORM SEWER  
WATERMAIN  
SAN MH / PIPE STUB / PIPE OUTLET  
STM MH / CBMH / DCBMH / OGS  
CB / DCB / AD / TD  
HYDRANT / SIAMESE / METER CHAMBER  
VALVE BOX / VALVE CHAMBER  
WAT BENDS: 11.25° / 22.5° / 45° / 90°  
WAT TEE / CROSS / REDUCER

BENCHMARK:  
ELEVATIONS SHOWN HEREON ARE GEODETIC AND ARE REFERRED TO THE TOWN OF WHITCHURCH-STOUFFVILLE BENCHMARK NO. 768488 HAVING AN ELEVATION OF 255.29 M. LOCATED 115.81Y ALUMINUM SIGN HOUSE ON THE SE COR. OF THE JUNCTION OF HWY #48 AND HWY #47 AT RINDWOOD, 96.3 M E OF CL. OF HWY #48, AND 22.2 M S OF CL. OF HWY #47. TABLE SET HORIZONTALLY IN W FACE OF CONC FOUNDATION 3.1 M S OF NW COR. 69 CM BELOW ALUMINUM SIGNS AND 30 CM ABOVE GROUND LEVEL. ZONE 10 NAD83 (GRS83) COORDINATES TO URBAN ACCURACY PER SEC. 14 (2) OF O. REG. 216/10.

SITE PLAN: TAES ARCHITECTS  
SURVEY: MANDARIN SURVEYORS

NO.	ISSUE	DATE	BY
2	OPA AND ZBA - SUBMISSION 2	20250609	BD
1	ZBA - SUBMISSION 1	20240304	TF

DRAWING NOTES NOT FOR CONSTRUCTION

- THIS DRAWING IS THE EXCLUSIVE PROPERTY OF TYLIN. THE REPRODUCTION OF ANY PART WITHOUT PRIOR WRITTEN CONSENT FROM TYLIN IS STRICTLY PROHIBITED.
- THIS DRAWING IS TO BE READ AND UNDERSTOOD IN CONJUNCTION WITH ALL OTHER DRAWINGS AND DOCUMENTS APPLICABLE TO THIS PROJECT.
- THIS DRAWING IS NOT TO BE ISSUED FOR CONSTRUCTION UNTIL ALL REQUIRED PERMITS HAVE BEEN ISSUED.
- THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS, ELEVATIONS, INVERTS AND DATA ON SITE AND REPORT ANY DISCREPANCIES OR OMISSIONS TO TYLIN 48 HOURS PRIOR TO ANY CONSTRUCTION.

ABBREVIATIONS	TW	BW	HOPE
GENERAL: PROP = PROPOSED EX = EXISTING ELEVATIONS: TC = TOP OF CURB BC = BOTTOM OF CURB	STM = STORM SAN = SANITARY WAT = WATER PVC = POLYVINYL CHLORIDE	TOP OF WALL BOTTOM OF WALL	HIGH DENSITY POLYETHYLENE CONCRETE MAINTENANCE HOLE CATCH BASIN DOUBLE CATCH BASIN AREA DRAIN TRENCH DRAIN



**TYLin**  
3381 STEELES AVENUE E  
SUITE 315  
TORONTO, ON  
M2H 3S8  
p: 905.738.5700  
f: 905.738.0065

5688 MAIN STREET  
WHITCHURCH-STOUFFVILLE

SERVICING PLAN

SCALE: 1:250	PROJECT # 100319
DATE: DEC 2023	DRAWING #
DRAWN BY: HE	S1
DESIGNED BY: HE	
CHECKED BY: BD	